DATE	SYM	REVISION RECORD	AUTH.	DR.	CK.

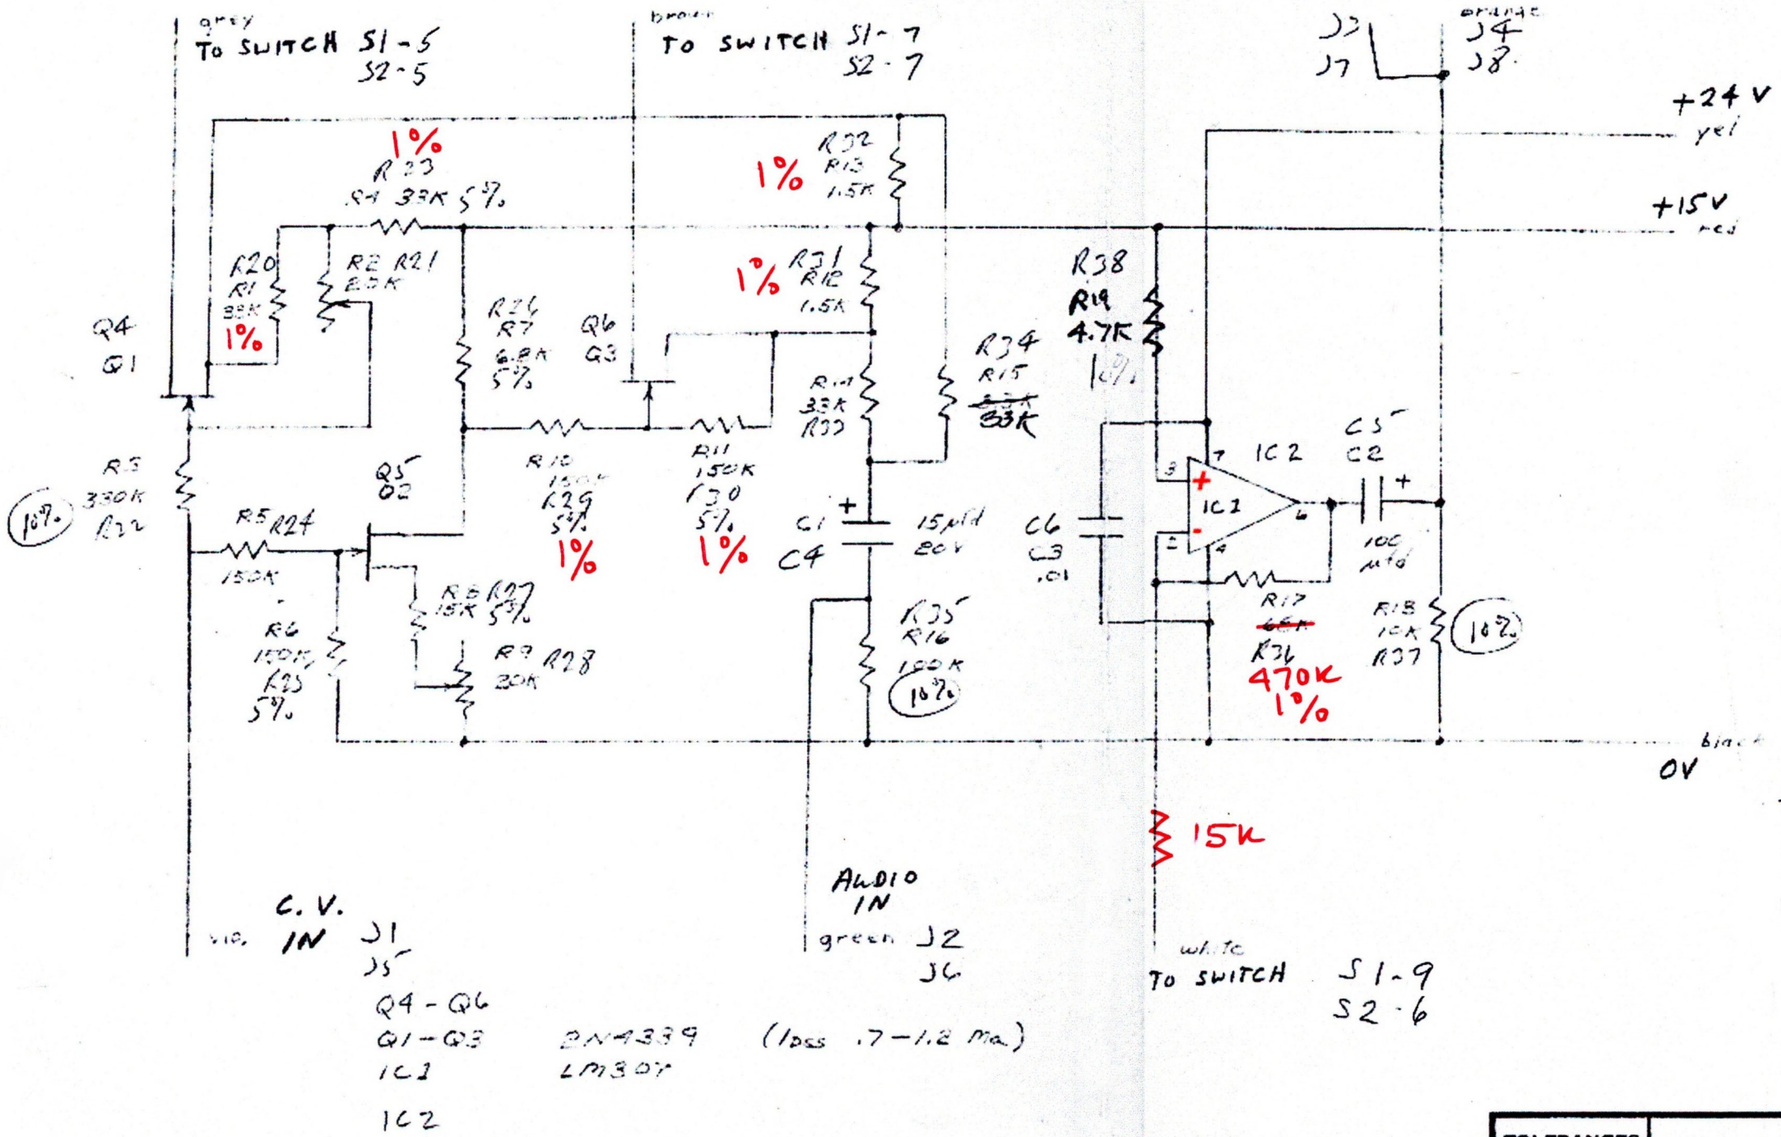

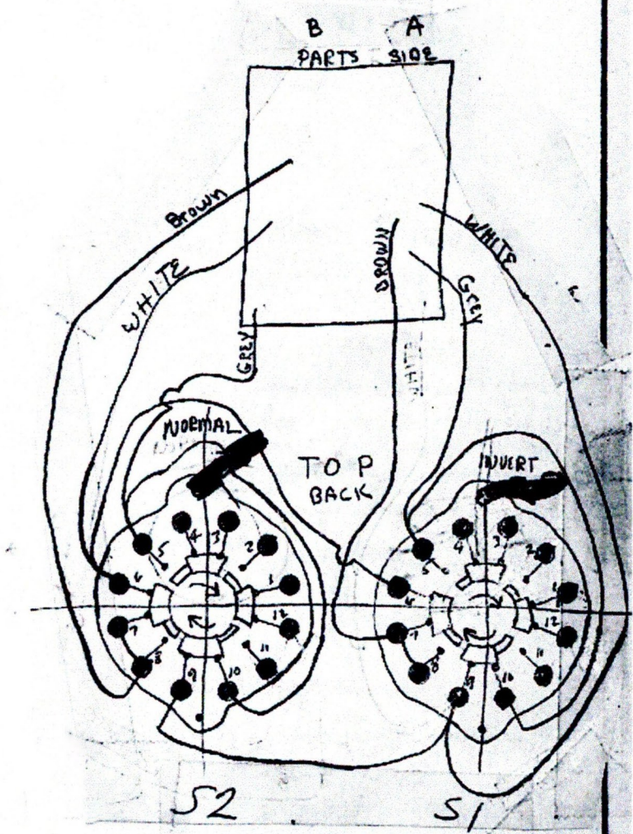

Q4 - Q6
Q1 - Q3 2N4339 (Idss .7 - 1.2 ma)
IC1 LM301
IC2

R1 - R19
R20 - R38
C1 - C3
C4 - C6

ALL R's 5% 1/4W (EXCEPT AS NOTED)

TOLERANCES (EXCEPT AS NOTED)	BUSHLA ASSOCIATES		
DECIMAL ±	MEMS	SCALE —	DRAWN BY BH / APPROVED BY
FRACTIONAL ±	TITLE SCH: DUAL STEREO LOCATOR mod. 1C2		
ANGULAR ±	DATE 8/15/69	DRAWING NUMBER B1020	

K+E CRYSTALENE® 10-8465 ENGINEERS' STANDARD FORM
MADE IN U.S.A. 26803