


DATE	SYM	REVISION RECORD	AUTH.	DR.	CK.

R_{22} 10 Ω ——— +15
 R_{23} 10 Ω ——— -15
 (quiet) } ^{to} power supply

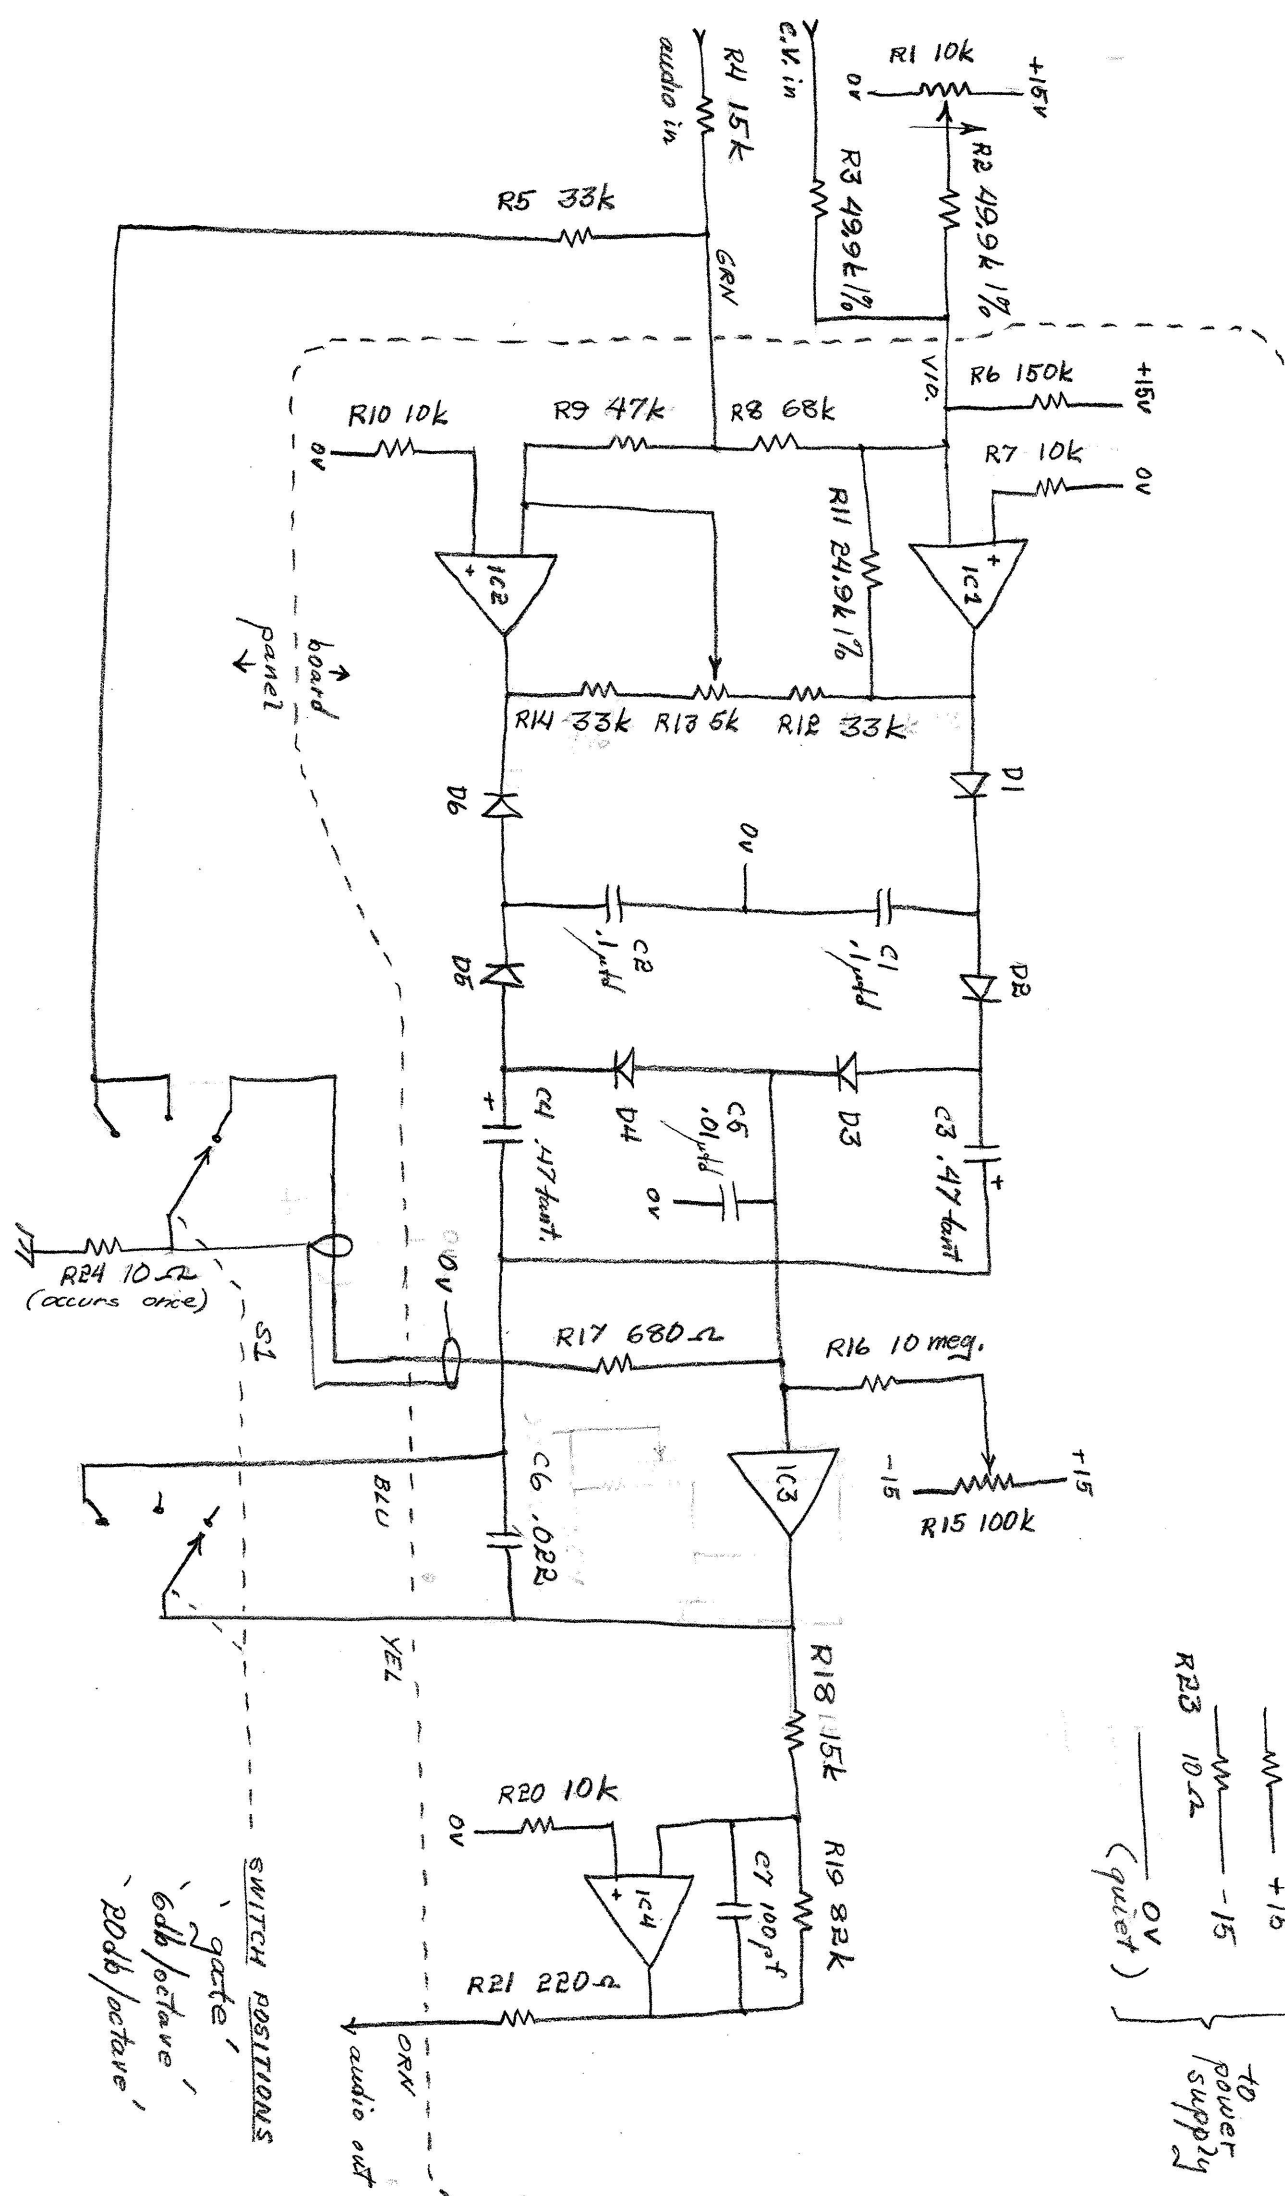

X4
 D1-6 MOT IN5228B
 IC1,2,4 5N72741P
 IC3 LM 302
 S1 CK toggle #7211
 R's 24
 C's 7

in filter mode,
 noise at IC3 is 20 μ v midband
 8 μ v at 5cps, 20kc
 S/N > 80db

TOLERANCES (EXCEPT AS NOTED)				BUCHLA ASSOCIATES	
DECIMAL	±	200 series	SCALE	DRAWN BY	DB
FRACTIONAL	±	TITLE		APPROVED BY	
		SCH ; LOPASS FILTER MODEL 292			
ANGULAR	±	DATE	DRAWING NUMBER		
		7-1-70	B 2920	DBS	